

# CERTIFICATE

Certified Passive House Component


Component-ID 0605wi03 valid until 31st December 2024

Passive House Institute

Dr. Wolfgang Feist

64283 Darmstadt

Germany

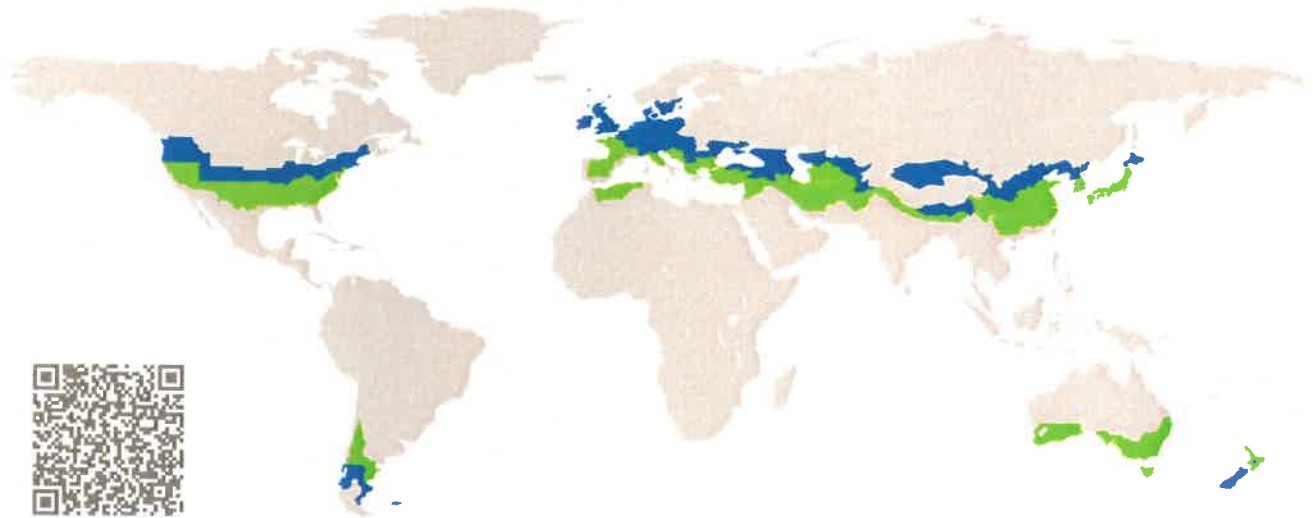


Category: **Window Frame**  
Manufacturer: **Aluprof S.A.,  
Bielsko-Biala,  
Poland**  
Product name: **MB-104 Passive SI**

**This certificate was awarded based on the following  
criteria for the cool, temperate climate zone**

Comfort  $U_W = 0.80 \leq 0.80 \text{ W}/(\text{m}^2 \cdot \text{K})$   
 $U_{W,\text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \cdot \text{K})$   
with  $U_g = 0.70 \text{ W}/(\text{m}^2 \cdot \text{K})$

Hygiene  $f_{Rsi=0.25} \geq 0.70$

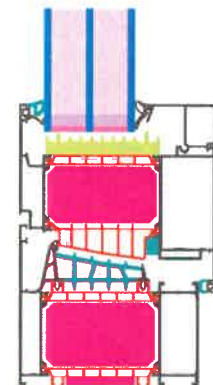

Passive House  
efficiency class

phE

phD

phC

phB

phA


[www.passivehouse.com](http://www.passivehouse.com)

cool, temperate climate




**CERTIFIED  
COMPONENT**


Passive House Institute

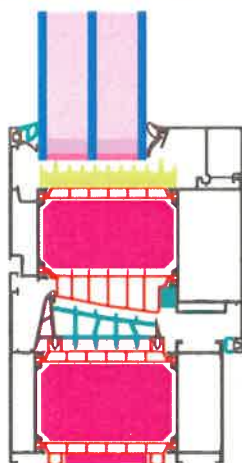

Calculation model

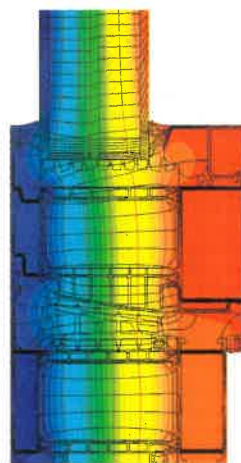

Isothermal



## Description

Aluminium frame with insulation core made of expanded polystyrene and rebate insulation of polyethylene foam. Pane thickness: 48 mm (4/18/4/18/4), Rebate depth: 15 mm.

## Explanation

The window U-values were calculated for the test window size of 1.23 m × 1.48 m with  $U_g = 0.70 \text{ W}/(\text{m}^2 \cdot \text{K})$ . If a higher quality glazing is used, the window U-values will improve as follows:




Glazing	$U_g =$	0.70	0.64	0.58	0.54	$\text{W}/(\text{m}^2 \cdot \text{K})$
		↓	↓	↓	↓	
Window	$U_w =$	0.80	0.76	0.73	0.70	$\text{W}/(\text{m}^2 \cdot \text{K})$





Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

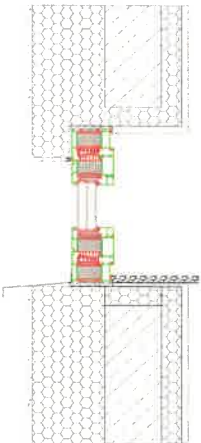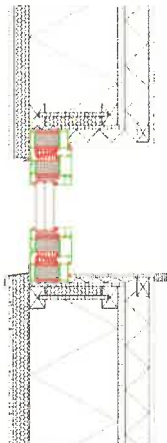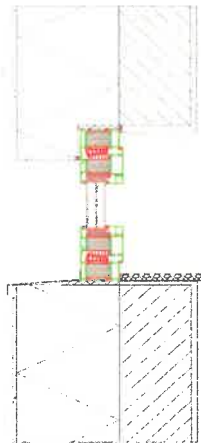Further information relating to certification can be found on [www.passivehouse.com](http://www.passivehouse.com) and [passipedia.org](http://passipedia.org).

## Validated installations

Formwork blocks (operable)	Lightweight timber (operable)	Exterior insulation and finishing system (EIFS) (operable)
		
$\Psi_{\text{install}}$ W/(m · K)	$\Psi_{\text{install}}$ W/(m · K)	$\Psi_{\text{install}}$ W/(m · K)
Top 0.010	Top 0.015	Top 0.011
Side 0.010	Side 0.015	Side 0.011
Bottom 0.022	Bottom 0.029	Bottom 0.029
$U_{W, \text{installed}} = 0.84 \text{ W/(m}^2 \cdot \text{K)}$	$U_{W, \text{installed}} = 0.85 \text{ W/(m}^2 \cdot \text{K)}$	$U_{W, \text{installed}} = 0.85 \text{ W/(m}^2 \cdot \text{K)}$

Frame values		Frame width $b_f$ mm	U-value frame $U_f$ W/(m <sup>2</sup> · K)	$\psi$ -glazing edge $\psi_g$ W/(m · K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Flying Mul- lion	(FM1) 	182	0.77	0.020	0.77
Bottom	(OB1) 	150	0.83	0.021	0.77
Top	(OH1) 	150	0.83	0.021	0.77
Lateral	(OJ1) 	150	0.83	0.021	0.77
Spacer: SWISSPACER Ultimate			Secondary seal: Polysulfide		

